



Property Risk Consulting Guidelines

BELT CONVEYORS IN THE SUGAR INDUSTRY

INTRODUCTION AND SCOPE

Belt conveyors transport material between stages of processing. This Guideline excludes other type of sugar conveyances such as bucket elevators, screw conveyors, and beet flumes.

Because belt conveyors are often the only efficient way to move such materials, conveyor failures can cause lengthy business interruptions, particularly if belt drive mechanisms or housings are damaged. The primary causes of conveyor belt fires are:

- Frictional heat resulting from belts slipping or jamming, uneven loading of long belts, or bearings failing;
- Electrical equipment arcing, malfunction or overload;
- Conveyed material that may have undergone spontaneous heating in storage or other types of heating.
- Sparks from cutting and welding operations.

All rubber or synthetic belts, such as neoprene and polyvinyl chloride belts, are combustible—even those passing conveyor belt fire tests (see [Discussion](#)). Once ignited, these belts produce intensely hot, smoky fires. Therefore, belt conveyors require some form of fire protection, regardless of the materials conveyed. Conveyor drives and gears also require protection against electrical and mechanical breakdown.

POSITION

Incorporate the following loss prevention and control measures in facilities with any belt conveyors.

Management Programs

Incorporate the elements of *OVERVIEW* applicable to conveyor operations. Include the following provisions:

Smoking Regulations

Do not permit smoking where discarded materials could reach a conveyor belt. This includes yard storage areas, conveyor enclosures, transfer houses and areas near open conveyors.

Maintenance

Put all maintenance procedures and schedules for the conveyors in a written maintenance program. Incorporate manufacturers' recommendations into the program. Also include frequencies for testing

indicator lights, alarms and conveyor interlocks. Review inspection, testing and maintenance records, and take action whenever procedures are not followed.

Maintain transformers in accordance with PRC.5.9.1 and maintain motors per manufacturer's recommendations.

Examine all bearings for overheating at least weekly using an infrared thermometer or scanner. Monitor inaccessible bearings with fixed thermocouples. Inspect and maintain gears and monitor for vibration.

At least weekly, check for abnormal vibration in belt drives, turning pulleys, tensioning pulleys and other heavily loaded pulleys operating at more than 60 rpm (1 Hz).

Provide spares for equipment with long lead time, such as complex or specialized gear sets and tensioners.

Pre-Emergency Planning

Train the emergency response team to handle emergencies involving conveyor systems. Include the location and use of conveyor system controls in the training. Plan how every part of the conveyor system will be reached in an emergency.

Provide self-contained breathing apparatus for fire brigades, particularly where facilities have extensive enclosed or underground conveyor runs. Train brigades to use this apparatus.

Have enough spare belting and parts available to repair or replace damaged portions of any conveyor system. Anticipate probable maximum damage and downtime. Standardizing conveyor drives will reduce the need for different types of spare belting or drive components. Spare belting for the longest conveyor of each belt width will usually be sufficient. Belting can always be cut shorter to replace belts on shorter conveyors.

Hot Work

Take special precautions when performing hot work on or near any conveyor system. Make sure the conveyor is stopped and all belting and other combustible materials are properly covered. Provide a fire watch. Have charged hose lines available to all work areas.

Loss Prevention Inspection

Walk the entire conveyor system during each operating shift. Look for loose or stuck rollers, frayed belts, and material accumulating under belts, and abnormal noise or vibration.

Housekeeping

Regularly inspect conveyor belts and remove material accumulations. Also check for combustibles in enclosures, under belts or anywhere else they may expose the belts.

Fixed Active Fire Protection

Provide automatic closed head sprinkler or water spray systems to protect conveyor belts and drives when conveyors have **any** of the following features:

- Are fully enclosed or have limited access. For example, the conveyors may be located high above grade or inside tunnels, or they may have access at one end only.
- Present a substantial business interruption potential.
- Are covered by combustible enclosures.
- Transport of combustible materials (sugar itself can be treated as non-combustible due to slow burning rates).

Conveyors transporting noncombustible materials do not require automatic sprinkler protection if they are located within noncombustible galleries, provided the galleries are located at ground level or are partly open and elevated no higher than 40 ft (12.2 m). However, the facility must provide adequate manual fire fighting equipment, e.g., hose stations and hydrants, and fire fighting accessibility.

In general, ceiling sprinklers adequately protect open conveyors inside buildings. However, if partial or full enclosures shield conveyors from overhead sprinklers, provide a fixed fire protection system covering the entire shielded area. Also provide sprinklers under conveyors over 4 ft (1.2 m) wide, because they obstruct the ceiling sprinklers. See Figure 1.

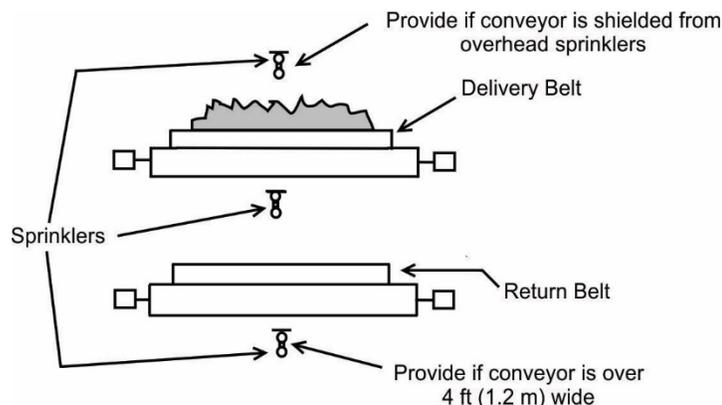


Figure 1. Sprinkler Locations For Protecting Conveyor Belts.

Automatic closed head sprinklers are adequate in most circumstances. However, provide automatic open head water spray systems to protect conveyor belts and drives when conveyors have **any** of the following characteristics:

- Conveyor belts over 4 ft (1.2 m) wide.
- Stacked conveyor belts.
- Conveyors on steep slopes where a fire could overrun automatic sprinkler protection. Generally, conveyors inclined more than 30° present a high fire spread potential.

Protect all transfer houses with an automatic closed head sprinkler or water spray system designed to provide a density of 0.25 gpm/ft² (10.2 L/min/m²) over the most hydraulically remote 2500 ft² (232 m²).

Closed Head Automatic Sprinkler Protection

Design automatic closed head sprinkler systems to discharge (0.25 gpm/ft²) 10.2 L/min/m² over the most hydraulically remote 2000 ft² (186 m²) of conveyor or conveyor enclosure. For unenclosed single-line conveyors, provide a discharge of 0.25 gpm/ft² (10.2 L/min/m²) over the most hydraulically remote 100 ft (30 m) of conveyor length. Install sprinkler systems in accordance with NFPA 13. Closed head water spray systems designed in accordance with NFPA 15 can also be used.

Limit the maximum distance between sprinklers to 10 ft (3 m) along the conveyor length. Also limit the width covered by a single line of sprinklers to 10 ft (3 m). If possible, locate sprinklers over the centerline of the bottom and top belts for early response to a fire. Although sprinkler discharge will not ensure that the fire will be fully extinguished under the belt, the fire will probably be controlled by stopping the conveyor. More importantly, the belt rollers, supporting framework, and the structural supports of the conveyor housing will sustain minimal damage.

Use automatic sprinklers rated at 165°F (74°C), having a 1/2 in. (15 mm) nominal orifice. Where high ambient temperatures are expected, use heads with ratings at least 50°F (28°C) above the maximum ambient temperature. Use only equipment listed by a nationally recognized testing laboratory.

Sprinkler heads with an elongated spray pattern specifically designed for conveyors are available. They are rated at 165°F (74°C) with a 1/2 in. (15 mm) nominal orifice and may be either standard or fast response. The spray pattern allows for spacing the heads more than 10 ft (3 m) apart. However, use extreme care when designing and installing systems using this type of head. Head location and orientation strongly affect system design. Orifices smaller than 1/2 in. (15 mm) nominal are available but are not recommended because they may become plugged.

Wet pipe systems are preferred; however, many conveyors are in an unheated environment. Dry pipe systems are acceptable if the systems drain promptly and if quick opening devices are provided for large volume systems. Quick opening devices may also be required for systems smaller than 500 gal (1900 L) to achieve an acceptable water delivery time.

Preaction systems may be used. These systems can detect a fire earlier, but only if detectors are properly maintained. In extremely cold climates, evaluate the possibility that water in the branch lines may freeze between the time fire is detected and the time the sprinklers operate.

Open Head Automatic Water Spray Protection

Design water spray systems to direct water spray on the drive unit and the bottom and top belts at a rate of 0.25 gpm/ft² (10.2 L/min/m²) over the protected area. Install water spray protection in accordance with NFPA 15.

Locate all water spray nozzles in accordance with listing requirements. Limit the maximum distance between water spray nozzles to 10 ft (3 m) along the conveyor length. Also limit the width covered by a single line of nozzles to 10 ft (3 m).

Nozzles with an elongated spray pattern, having a 1/2 in. (15 mm) nominal orifice and specifically designed for conveyors, can also be used. The elongated spray pattern allows the nozzles to be spaced more than 10 ft (3 m) apart. However, use extreme care when designing and installing systems using these types of nozzles. Nozzle location and orientation strongly affect system design. Consult the manufacturer's manuals for more information.

High Expansion Foam Protection

High expansion foam systems can be used in underground tunnels where excessive water discharge is not acceptable. Design these systems in accordance with NFPA 11 and PRC.12.3.2.1.

Passive Fire Protection

Although active fire protection is preferred, it may not be practical to provide it just for the conveyors if there is no other active fire protection. In this case, provide shutters such as the Stöbich System, activated by smoke detection.

Conveyor Belts Handling Dust-Laden Products

Dry agricultural and sugar that include finer particles, are subject to explosions. Arrange and protect conveyors handling such materials in accordance with the provisions pertaining to conveyors in NFPA 61 *Standard for the Prevention of Fires and Dust Explosions in Agricultural and Food Processing Facilities*. Key points are listed below; however, the entire document should be reviewed.

- Enclosed conveyors present a dust explosion potential and should meet guidelines on dust explosion prevention and mitigation.
- Stop the conveyor if the discharge end becomes plugged.
- Belts should be ATEX rated (in countries where ATEX applies) anti-static (conductive) and fire resistant as discussed elsewhere in this guideline.
- Where conveyors feed any kind of size reduction (such as powdered sugar) devices such as magnets should be used to prevent foreign object intrusion.
- Outward opening doors should be provided for cleaning, inspections, and firefighting.
- Anti-friction bearings should be used.
- Conveyors should be located outside of machinery enclosures and isolated from the product stream to minimize exposure to dust and to be more accessible for inspection and service.

Hose Connections

Place 1 in. (25 mm) hose connections equipped with a 1½ in. (40 mm) woven-jacketed-lined fire hose and an adjustable spray nozzle at intervals needed to ensure that hose streams can reach all parts of the conveyor systems.

In cold climates, use either dry or preaction systems to supply hose stations in unheated conveyors and galleries. Slope piping for adequate drainage back to the valve. Provide a preaction system with a remote trip station at each hose station. Protect pressure relief valves and piping downstream of check valves from freezing.

Water Supplies

Design water supplies to meet the sprinkler or water spray demand plus a minimum 250 gpm (945 L/min) for hose streams for 2 hr.

Detection and Interlocks

When spacing and locating fire detectors, consider the following:

- Material being conveyed and the speed it is traveling;
- Relative combustibility of the belt;
- Detection speed needed;
- Detection required between upper and lower belts and above the upper belt.

Thermostatic cable or other heat detectors, flame detectors and fusible links can be used in fire detection and protection actuation systems.

Provide manual shutdown capability for the conveyor system. Also provide an interlock to shut down the conveyor system when the sprinkler, water spray or detection system actuates. Arrange conveyors so that they can be run manually after they are shut down to permit burning materials to be moved to an area accessible for firefighting.

Monitor belt alignment and belt speed. Interrupt driving power and shut down the system upon sensing a serious misalignment or a 20% reduction in belt speed. Also consider providing devices which detect damaged belts.

Provide an alarm that transmits signals to a constantly attended location when any detection system actuates or when there is:

- Indication of water flow in the sprinkler piping;
- Detection of belt slowdown, misalignment or damage.

Provide automatic bearing temperature monitors for key bearing assemblies and motors interlocked to shut down the conveyor system.

Fire Extinguishers

Install portable fire extinguishers no more than 100 ft (30 m) apart throughout conveyor galleries.

Drainage

Provide drainage facilities that will prevent excessive sprinkler and hose stream water from flowing down inclined and overhead conveyors. If this is neglected, ice, water or saturated spilled material may build up and cause a structural collapse. Wherever conveyors go underground, provide diversion curbing at grade level to intercept any water rundown from the aboveground segments. Provide adequate sump pump or dry well facilities to remove water.

Mechanical Protection

Recognize and guard against the potential for oversized chunks of conveyed material mechanically damaging sprinklers, piping and detectors. Install such equipment where existing construction, such as beams and girders, can provide maximum protection.

Exposure

Eliminate trash accumulations, grass or brush growths, outside storage or combustible buildings that expose conveyor housings and supports, or move them at least 25 ft (7.5 m) away. Where a serious

exposure cannot be eliminated or controlled, provide sprinklers for external protection of major conveyor structures.

DISCUSSION

A conveyor consists of a closed loop belt assembled over a drive or head pulley and a driven pulley. These pulleys are usually, but not always, located at opposite ends of the conveyor. The belt travels between the two pulleys on idler pulleys supported on a steel framework. A conveyor system is a series of interconnected belts and transfer points.

Conveyors may be totally or partly enclosed in combustible or noncombustible subgrade, grade or abovegrade galleries. A totally enclosed gallery has no continuous openings along its sides or floor. A partly open gallery has continuous openings along its sides or bottom. An open gallery has no housing or hood.

The mechanical and electrical systems driving a conveyor can cause a belt to catch fire. The belt alone provides enough combustible loading to spread the fire. When the materials conveyed are combustible, these fires are even more difficult to control.

Conveyor belt sizes range from less than 12 in. (0.3 m) to over 6 ft (2 m) wide and thousands of feet long. Belts operate from nearly zero to many hundreds of feet per minute. Major fires have spread on belts only 2 ft (0.6 m) wide and on systems carrying noncombustible materials, such as limestone and iron ore. Once a fire has started on a conveyor, detecting and extinguishing the fire may be difficult. Fire and smoke will travel fast and spread to other conveyors at transfer points.

Many inclined conveyors ascend as high as 200 ft (90 m) above grade. Placing side-by-side or inclined conveyors on the same structure increases fire potential. Smoke, combustion products, rapid belt movement, and elevation above ground combine to make fire fighting extremely difficult in any conveyor system, especially in enclosed conveyors. This increases potential fire loss.

If the belt ignites and detection is delayed, the belt will usually burn through and separate. Belt tensioning equipment and gravity will pull the burning ends apart. On an inclined conveyor, pieces of belt may accumulate in transfer stations, at take-up towers, or in tunnels, or it may remain in a mass on the conveyor structure. A belt can also whip across an access catwalk onto a nearby, parallel conveyor and involve it in the fire. If the fire is not controlled, an accumulation of burning belt can quickly distort the steel structure and cause it to collapse from the heat of the belt fire.

Concern over conveyor belt combustibility has resulted in fire testing. AXA XL Risk Consulting has reviewed five conveyor belt fire tests. The US Mine Safety and Health Administration (MSHA) has developed a test for conveyor belts in conjunction with the United States Bureau of Mines (USBM). The test is called the large scale fire gallery; the gallery is 89.8 ft (27.4 m) long. To pass this test, a "portion" of a sample of belting "must remain unburned throughout its width," according to the USBM test description. Belts passing this test are marked "Fire Resistant, U.S.B.M. No."

Due to the expense of the large scale test, MSHA has since developed a small scale test with 5.9 ft (1.8 m) long test apparatus. The results of the small scale test have not been proven to correlate with those of the large scale test. Results for belts using this test are therefore not considered reliable.

FM Global has developed two tests for conveyor belts. One test is small scale (50 kW); the other, large scale (500 kW). These tests determine the flame propagation index (fpi), a dimensionless parameter indicating the rate of burning. Belts that receive an fpi of 7 or less in the 500 kW test are considered comparable to those passing the USBM test.

The ISO 340 test applies a flame to six samples of belting. Once the flame is removed from the sample, the belting should self-extinguish in 15 seconds. It cannot reignite when exposed to a stream of air.

Loss experience and test results confirm that all flexible conveyor belts, once ignited, will produce dense black, toxic smoke. Belts meeting ISO, USBM or FM Global, or similar criteria are less easily ignited, but they still require fire protection.

Business interruption is the most serious loss potential, particularly where conveyors are the only economical and feasible way to transport bulk materials from one elevation to another. When the belt support systems or the structural supports of the conveyor housing are seriously damaged, these losses are much worse.

For unusual situations not addressed in this guideline, please refer to PRC.9.3.1 which addresses general conveyors for industry.